


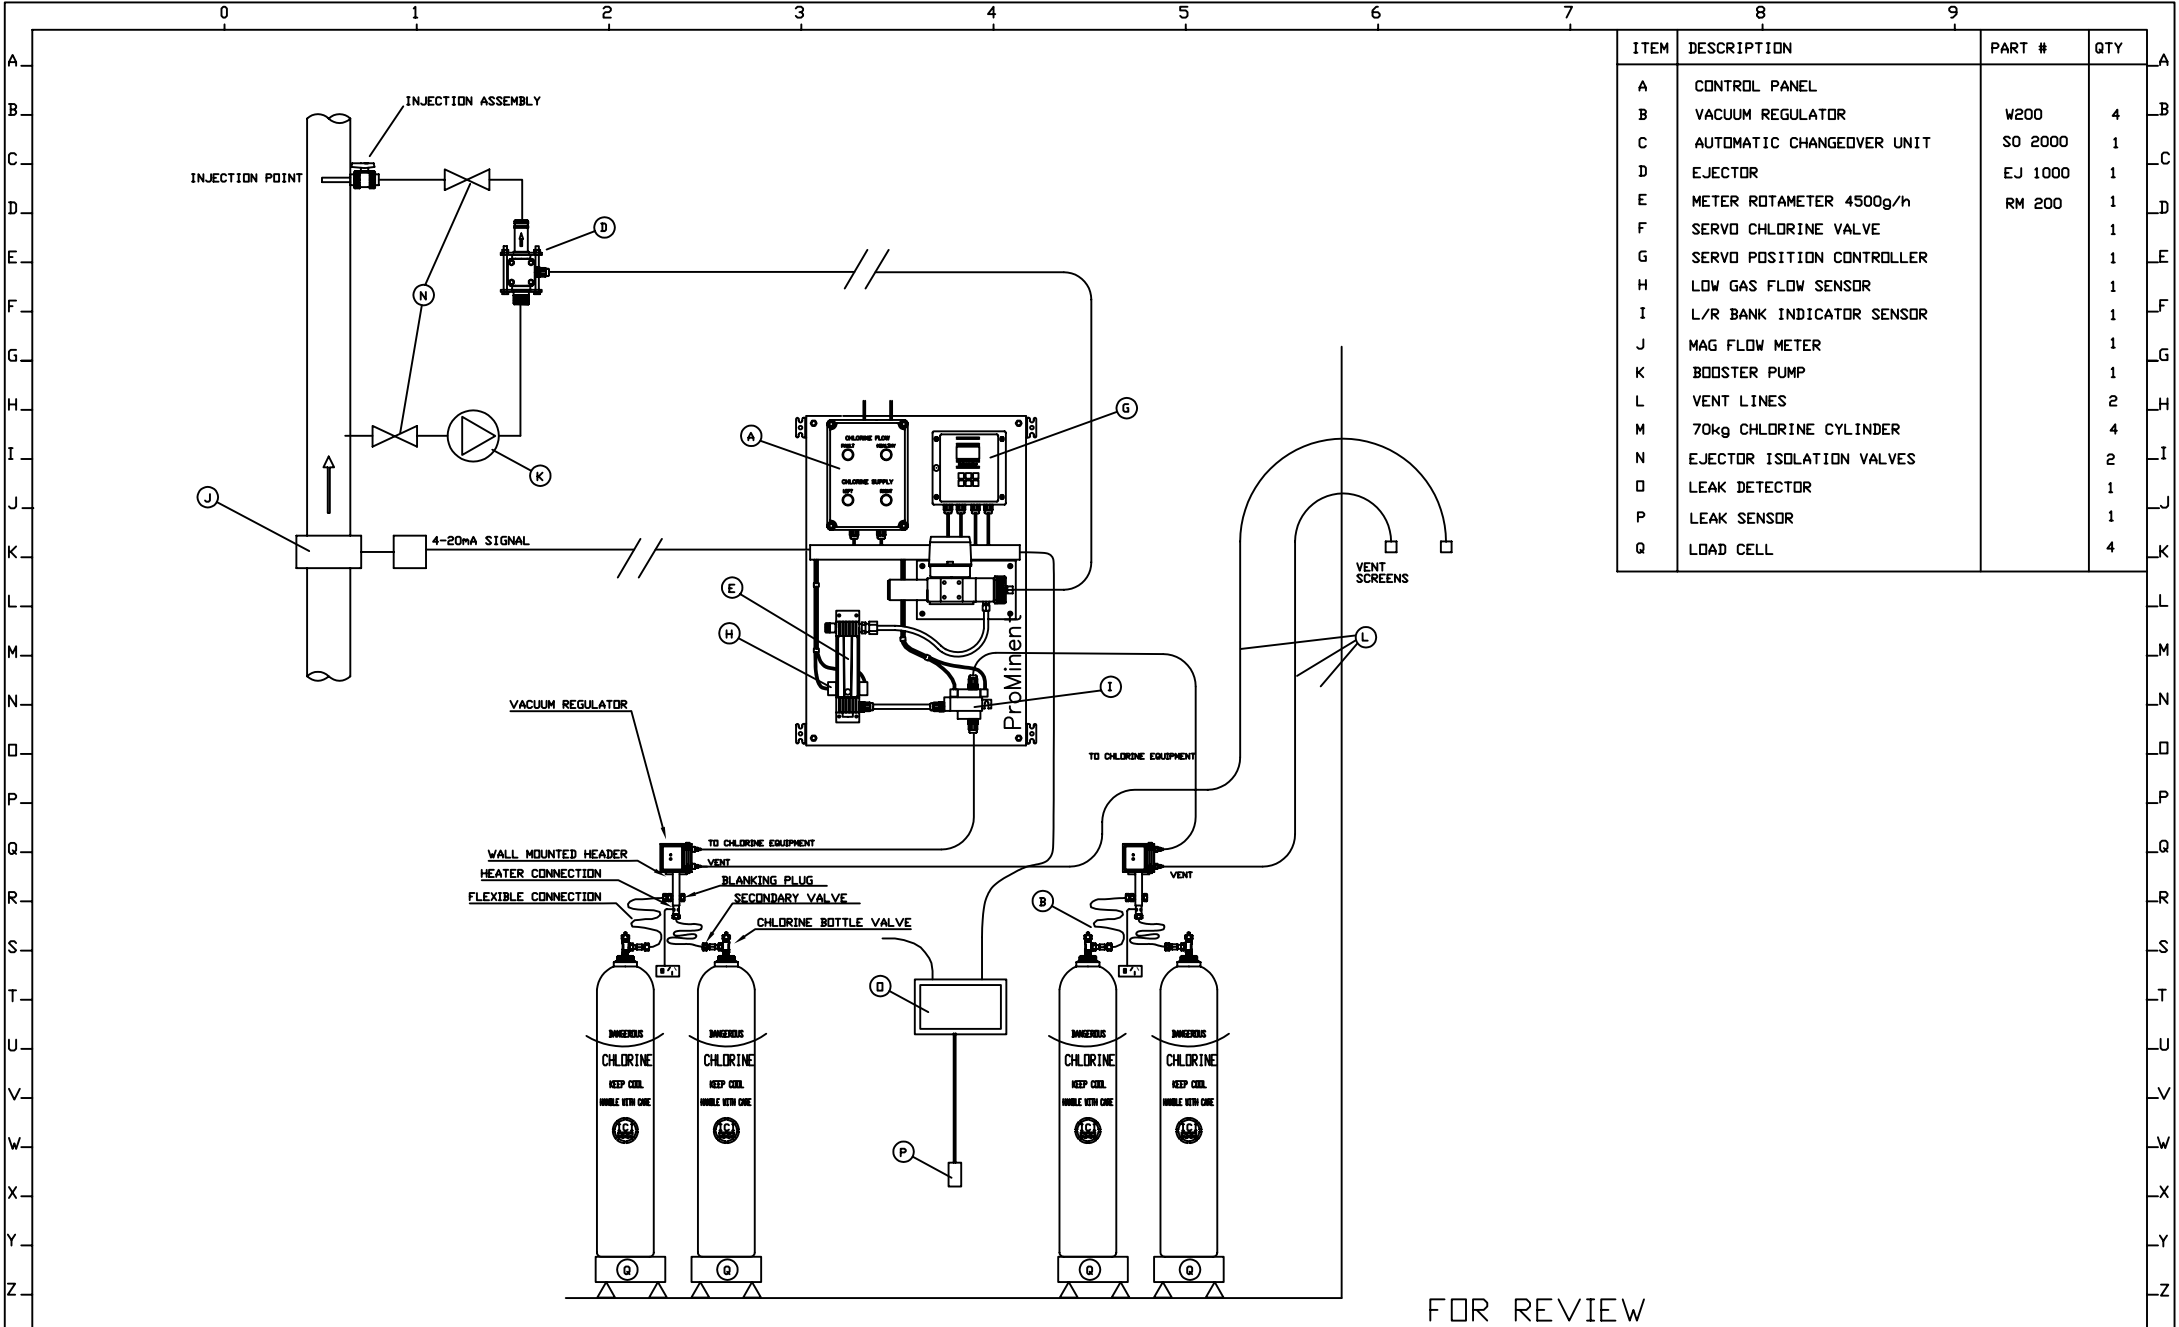

ITEM	DESCRIPTION	PART #	QTY
A	CONTROL PANEL		
B	VACUUM REGULATOR	W200	4
C	AUTOMATIC CHANGEDOVER UNIT	SO 2000	1
D	EJECTOR	EJ 1000	1
E	METER ROTAMETER 4500g/h	RM 200	1
F	SERVO CHLORINE VALVE		1
G	SERVO POSITION CONTROLLER		1
H	LOW GAS FLOW SENSOR		1
I	L/R BANK INDICATOR SENSOR		1
J	MAG FLOW METER		1
K	BOOSTER PUMP		1
L	VENT LINES		2
M	70kg CHLORINE CYLINDER		4
N	EJECTOR ISOLATION VALVES		2
O	LEAK DETECTOR		1
P	LEAK SENSOR		1
Q	LOAD CELL		4

FOR REVIEW

				This drawing remains the property of ProMinent Fluid Controls Pty Ltd. It shall not be copied in whole or in part, nor re-issued in any form to other parties without the express written approval of ProMinent Fluid Controls Pty Ltd.		SCALE: N.T.S.		DRAWING PREPARED BY ProMinent Fluid Controls Pty Ltd Unit 4, 4 Narabang Way BELROSE NSW 2085 Tel (02) 9450 0995 Fax (02) 9450 0996		PROMINENT FLUID CONTROLS 4 BOTTLE AUTO CHANGE OVER AUTOMATIC Cl2 GAS INJECTION SYSTEM		ProMinent®
						CAD FILE NAME: CL2GS-10						
						TOLERANCES LINEAR: ±1mm ANGULAR: ±1 DEGREE UNLESS STATED OTHERWISE		DRAWN: RDL	DATE: 08-12-98			
								CHECKED: SCC	DATE: 08-12-98			
REV:	DATE:	DESCRIPTION	APPROVED	FILE: N:\DATA\ENG\QUOTATION DWGS\Cl2 GAS SYSTEMS		SHEET1		OF 1	DRAWING NUMBER: CL2GS-10		REVISION: 0	